


HANDLING INSTRUCTIONS

EE894 - Digital Measurement Module for CO₂, Relative Humidity, Temperature and Barometric Pressure







CAUTION

- EE894 is an ESD sensitive devices and shall be handled with corresponding precautions.
- EE894 and mainly the CO₂ sensing cell shall not be exposed to any mechanical stress during installation or operation. Mechanical stress on the sensing cell can lead to relevant measurement errors.

CO₂ Sensing Cell



HANDLING AND MOUNTING

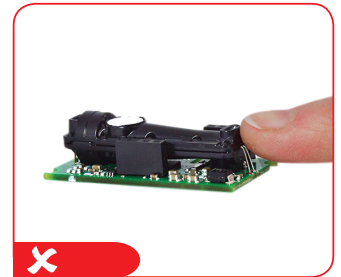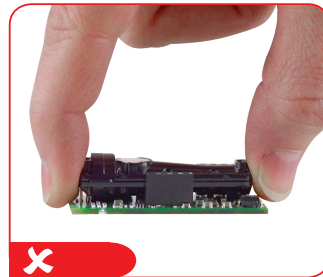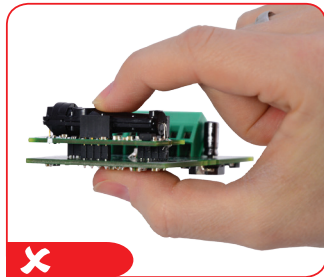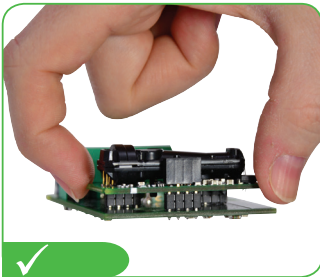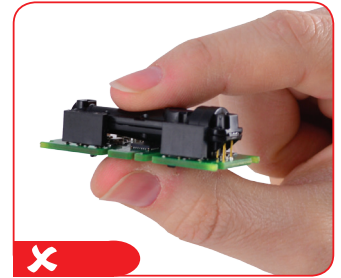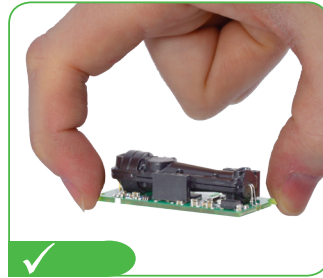

TECHNICAL DATA AND SUPPORT LITERATURE

Please see data sheet, specification, application notes and tutorials at:

- www.epluse.com/ee894

INFORMATION

+43 7235 605 0 / info@epluse.com

Langwiesen 7 • A-4209 Engerwitzdorf
 Tel: +43 7235 605-0 • Fax: +43 7235 605-8
info@epluse.com • www.epluse.com

LG Linz Fn 165761 t • UID-Nr. ATU44043101
 Place of Jurisdiction: A-4020 Linz • DVR0962759

